



Ministerio Público Fiscal de la Ciudad de Buenos Aires
Fiscalía General
Departamento de Infraestructura y Apoyo Operativo

Air System Design Load Summary for Zona 6

Project Name: Av. Cabildo 3067, 4° piso
 Prepared by: SS

04/05/2011
 11:10

	DESIGN COOLING			DESIGN HEATING		
	COOLING DATA AT Dec 1600			HEATING DATA AT DES HTG		
	COOLING OA DB / WB 34.0 °C / 23.7 °C			HEATING OA DB / WB -0.6 °C / -3.2 °C		
ZONE LOADS	Details	Sensible (W)	Latent (W)	Details	Sensible (W)	Latent (W)
Window & Skylight Solar Loads	5 m²	909	-	5 m²	-	-
Wall Transmission	7 m²	127	-	7 m²	231	-
Roof Transmission	70 m²	941	-	70 m²	869	-
Window Transmission	5 m²	191	-	5 m²	505	-
Skylight Transmission	0 m²	0	-	0 m²	0	-
Door Loads	0 m²	0	-	0 m²	0	-
Floor Transmission	70 m²	0	-	70 m²	0	-
Partitions	90 m²	0	-	90 m²	0	-
Ceiling	0 m²	0	-	0 m²	0	-
Overhead Lighting	1890 W	1769	-	0	0	-
Task Lighting	0 W	0	-	0	0	-
Electric Equipment	5950 W	5779	-	0	0	-
People	18	1156	1051	0	0	0
Infiltration	-	0	0	-	0	0
Miscellaneous	-	0	0	-	0	0
Safety Factor	5% / 5%	544	53	5%	80	0
>> Total Zone Loads	-	11416	1104	-	1685	0
Zone Conditioning	-	11022	1104	-	1701	0
Plenum Wall Load	0%	0	-	0	0	-
Plenum Roof Load	0%	0	-	0	0	-
Plenum Lighting Load	0%	0	-	0	0	-
Return Fan Load	992 L/s	0	-	992 L/s	0	-
Ventilation Load	124 L/s	1361	1279	124 L/s	3245	0
Supply Fan Load	1067 L/s	20	-	1067 L/s	-20	-
Space Fan Coil Fans	-	0	-	-	0	-
Duct Heat Gain / Loss	5%	571	-	5%	84	-
>> Total System Loads	-	12973	2383	-	5010	0
Central Cooling Coil	-	12973	2384	-	0	0
Central Heating Coil	-	0	-	-	5010	-
>> Total Conditioning	-	12973	2384	-	5010	0
Key:	Positive values are cig loads Negative values are htg loads			Positive values are htg loads Negative values are cig loads		




Ministerio Público Fiscal de la Ciudad de Buenos Aires
Fiscalía General
Departamento de Infraestructura y Apoyo Operativo
Psychrometric Analysis for Zona 6

Project Name: Av. Cabildo 3067, 4° piso
Prepared by: SS

04/05/2011
11:10

Location: Buenos Aires, Argentina
Altitude: 19.8 m.
Data for: December DESIGN COOLING DAY, 1600

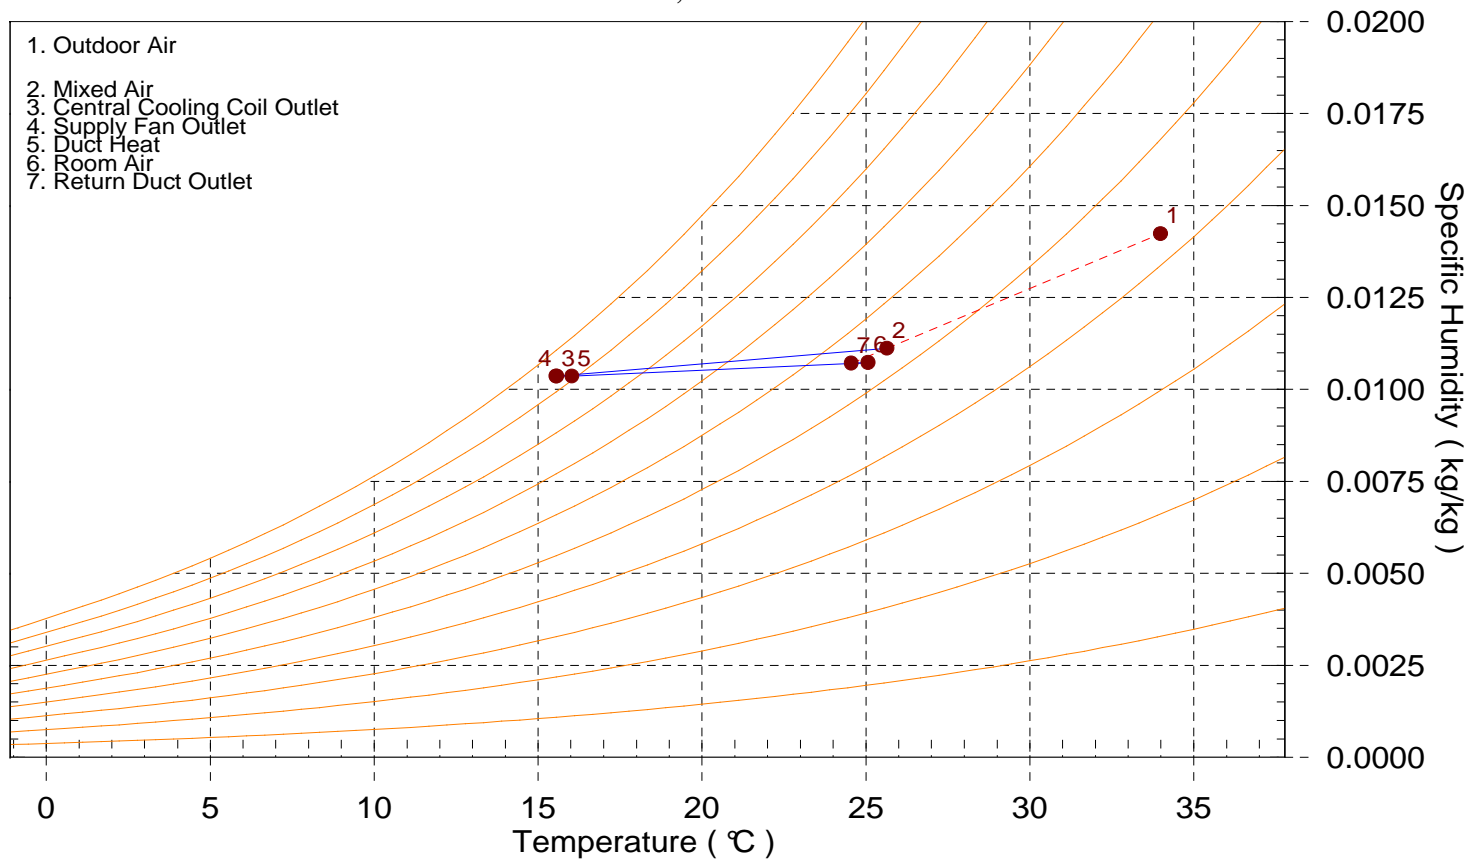



Ministerio Público Fiscal de la Ciudad de Buenos Aires
Fiscalía General
Departamento de Infraestructura y Apoyo Operativo

Space Design Load Summary for Zona 6

Project Name: Av. Cabildo 3067, 4° piso
 Prepared by: SS

04/05/2011
 11:10

TABLE 1.1.A. COMPONENT LOADS FOR SPACE " Zona 6 " IN ZONE " Zone 6 "						
	DESIGN COOLING			DESIGN HEATING		
	COOLING DATA AT Jan 1700 COOLING OA DB / WB 33.7 °C / 23.5 °C OCCUPIED T-STAT 23.9 °C			HEATING DATA AT DES HTG HEATING OA DB / WB -0.6 °C / -3.2 °C OCCUPIED T-STAT 21.1 °C		
		Sensible	Latent		Sensible	Latent
SPACE LOADS	Details	(W)	(W)	Details	(W)	(W)
Window & Skylight Solar Loads	5 m ²	906	-	5 m ²	-	-
Wall Transmission	7 m ²	152	-	7 m ²	231	-
Roof Transmission	70 m ²	999	-	70 m ²	869	-
Window Transmission	5 m ²	194	-	5 m ²	505	-
Skylight Transmission	0 m ²	0	-	0 m ²	0	-
Door Loads	0 m ²	0	-	0 m ²	0	-
Floor Transmission	70 m ²	0	-	70 m ²	0	-
Partitions	90 m ²	0	-	90 m ²	0	-
Ceiling	0 m ²	0	-	0 m ²	0	-
Overhead Lighting	1890 W	1776	-	0	0	-
Task Lighting	0 W	0	-	0	0	-
Electric Equipment	5950 W	5790	-	0	0	-
People	18	1162	1051	0	0	0
Infiltration	-	0	0	-	0	0
Miscellaneous	-	0	0	-	0	0
Safety Factor	5% / 5%	549	53	5%	80	0
>> Total Zone Loads	-	11528	1104	-	1685	0

TABLE 1.1.B. ENVELOPE LOADS FOR SPACE " Zona 6 " IN ZONE " Zone 6 "						
				COOLING	COOLING	HEATING
	Area	U-Value	Shade	TRANS	SOLAR	TRANS
	(m ²)	(W/(m ² ·K))	Coeff.	(W)	(W)	(W)
WNW EXPOSURE						
WALL	7	1.529	-	152	-	231
WINDOW 1	5	4.623	0.591	194	906	505
H EXPOSURE						
ROOF	70	0.573	-	999	-	869



Ministerio Público Fiscal de la Ciudad de Buenos Aires
Fiscalía General
Departamento de Infraestructura y Apoyo Operativo

Air System Sizing Summary for Zona 6

Project Name: Av. Cabildo 3067, 4° piso
 Prepared by: SS

04/05/2011
 11:10

Air System Information

Air System Name	Zona 6	Number of zones	1
Equipment Class	SPLT AHU	Floor Area	70.0 m²
Air System Type	SZCAV		

Sizing Calculation Information

Zone and Space Sizing Method:

Zone L/s	Sum of space airflow rates	Calculation Months	Jan to Dec
Space L/s	Individual peak space loads	Sizing Data	Calculated

Central Cooling Coil Sizing Data

Total coil load	15.4 kW	Load occurs at	Dec 1600
Sensible coil load	13.0 kW	OA DB / WB	34.0 / 23.7 °C
Coil L/s at Dec 1600	1067 L/s	Entering DB / WB	25.6 / 19.1 °C
Max block L/s	1067 L/s	Leaving DB / WB	15.6 / 14.9 °C
Sum of peak zone L/s	1013 L/s	Coil ADP	14.4 °C
Sensible heat ratio	0.845	Bypass Factor	0.100
m ² /kW	4.6	Resulting RH	54 %
W/m ²	219.4	Design supply temp.	14.4 °C
Water flow @ 5.6 K rise	N/A	Zone T-stat Check	1 of 1 OK
		Max zone temperature deviation	0.0 K

Central Heating Coil Sizing Data

Max coil load	5.0 kW	Load occurs at	Des Htg
Coil L/s at Des Htg	1067 L/s	W/m ²	71.6
Max coil L/s	1067 L/s	Ent. DB / Lvg DB	18.7 / 22.6 °C
Water flow @ 11.1 K drop	N/A		

Supply Fan Sizing Data

Actual max L/s	1067 L/s	Fan motor BHP	0.03 BHP
Standard L/s	1064 L/s	Fan motor kW	0.02 kW
Actual max L/(s-m ²)	15.24 L/(s-m²)	Fan static	10 Pa

Outdoor Ventilation Air Data

Design airflow L/s	124 L/s	l/s/person	7.08 l/s/person
L/(s-m ²)	1.77 L/(s-m²)		



Ministerio Público Fiscal de la Ciudad de Buenos Aires
Fiscalía General
Departamento de Infraestructura y Apoyo Operativo

Zone Design Load Summary for Zona 6

Project Name: Av. Cabildo 3067, 4° piso
 Prepared by: SS

04/05/2011
 11:10

Zone 6	DESIGN COOLING			DESIGN HEATING		
	COOLING DATA AT Jan 1700			HEATING DATA AT DES HTG		
	COOLING OA DB / WB 33.7 °C / 23.5 °C			HEATING OA DB / WB -0.6 °C / -3.2 °C		
	OCCUPIED T-STAT 23.9 °C			OCCUPIED T-STAT 21.1 °C		
ZONE LOADS	Details	Sensible (W)	Latent (W)	Details	Sensible (W)	Latent (W)
Window & Skylight Solar Loads	5 m ²	906	-	5 m ²	-	-
Wall Transmission	7 m ²	152	-	7 m ²	231	-
Roof Transmission	70 m ²	999	-	70 m ²	869	-
Window Transmission	5 m ²	194	-	5 m ²	505	-
Skylight Transmission	0 m ²	0	-	0 m ²	0	-
Door Loads	0 m ²	0	-	0 m ²	0	-
Floor Transmission	70 m ²	0	-	70 m ²	0	-
Partitions	90 m ²	0	-	90 m ²	0	-
Ceiling	0 m ²	0	-	0 m ²	0	-
Overhead Lighting	1890 W	1776	-	0	0	-
Task Lighting	0 W	0	-	0	0	-
Electric Equipment	5950 W	5790	-	0	0	-
People	18	1162	1051	0	0	0
Infiltration	-	0	0	-	0	0
Miscellaneous	-	0	0	-	0	0
Safety Factor	5% / 5%	549	53	5%	80	0
>> Total Zone Loads	-	11528	1104	-	1685	0



Ministerio Público Fiscal de la Ciudad de Buenos Aires
Fiscalía General
Departamento de Infraestructura y Apoyo Operativo

Zone Sizing Summary for Zona 6

Project Name: Av. Cabildo 3067, 4° piso
 Prepared by: SS

04/05/2011
 11:10

Sizing Calculation Information

Zone and Space Sizing Method:

Zone L/s **Sum of space airflow rates**
 Space L/s **Individual peak space loads**

Calculation Months **Jan to Dec**
 Sizing Data **Calculated**

Zone Sizing Data

Zone Name	Maximum Cooling Sensible (kW)	Design Air Flow (L/s)	Minimum Air Flow (L/s)	Time of Peak Load	Maximum Heating Load (kW)	Zone Floor Area (m²)	Zone L/(s-m²)
Zone 6	11.5	1013	1013	Jan 1700	1.7	70.0	14.48

Zone Terminal Sizing Data

No Zone Terminal Sizing Data required for this system.

Space Loads and Airflows

Zone Name / Space Name	Mult.	Cooling Sensible (kW)	Time of Load	Air Flow (L/s)	Heating Load (kW)	Floor Area (m²)	Space L/(s-m²)
Zone 6							
Zona 6	1	11.5	Jan 1700	1013	1.7	70.0	14.48